


500 kow

502-219

OENI TEST
GOLDMAN

Object	
No	mm ²
O	1/16
I	1/4
II	1
III	4
IV	16
V	64
No	Relat. Intens.
1	0,0315
2	0,100
3	0,315
4	1,00

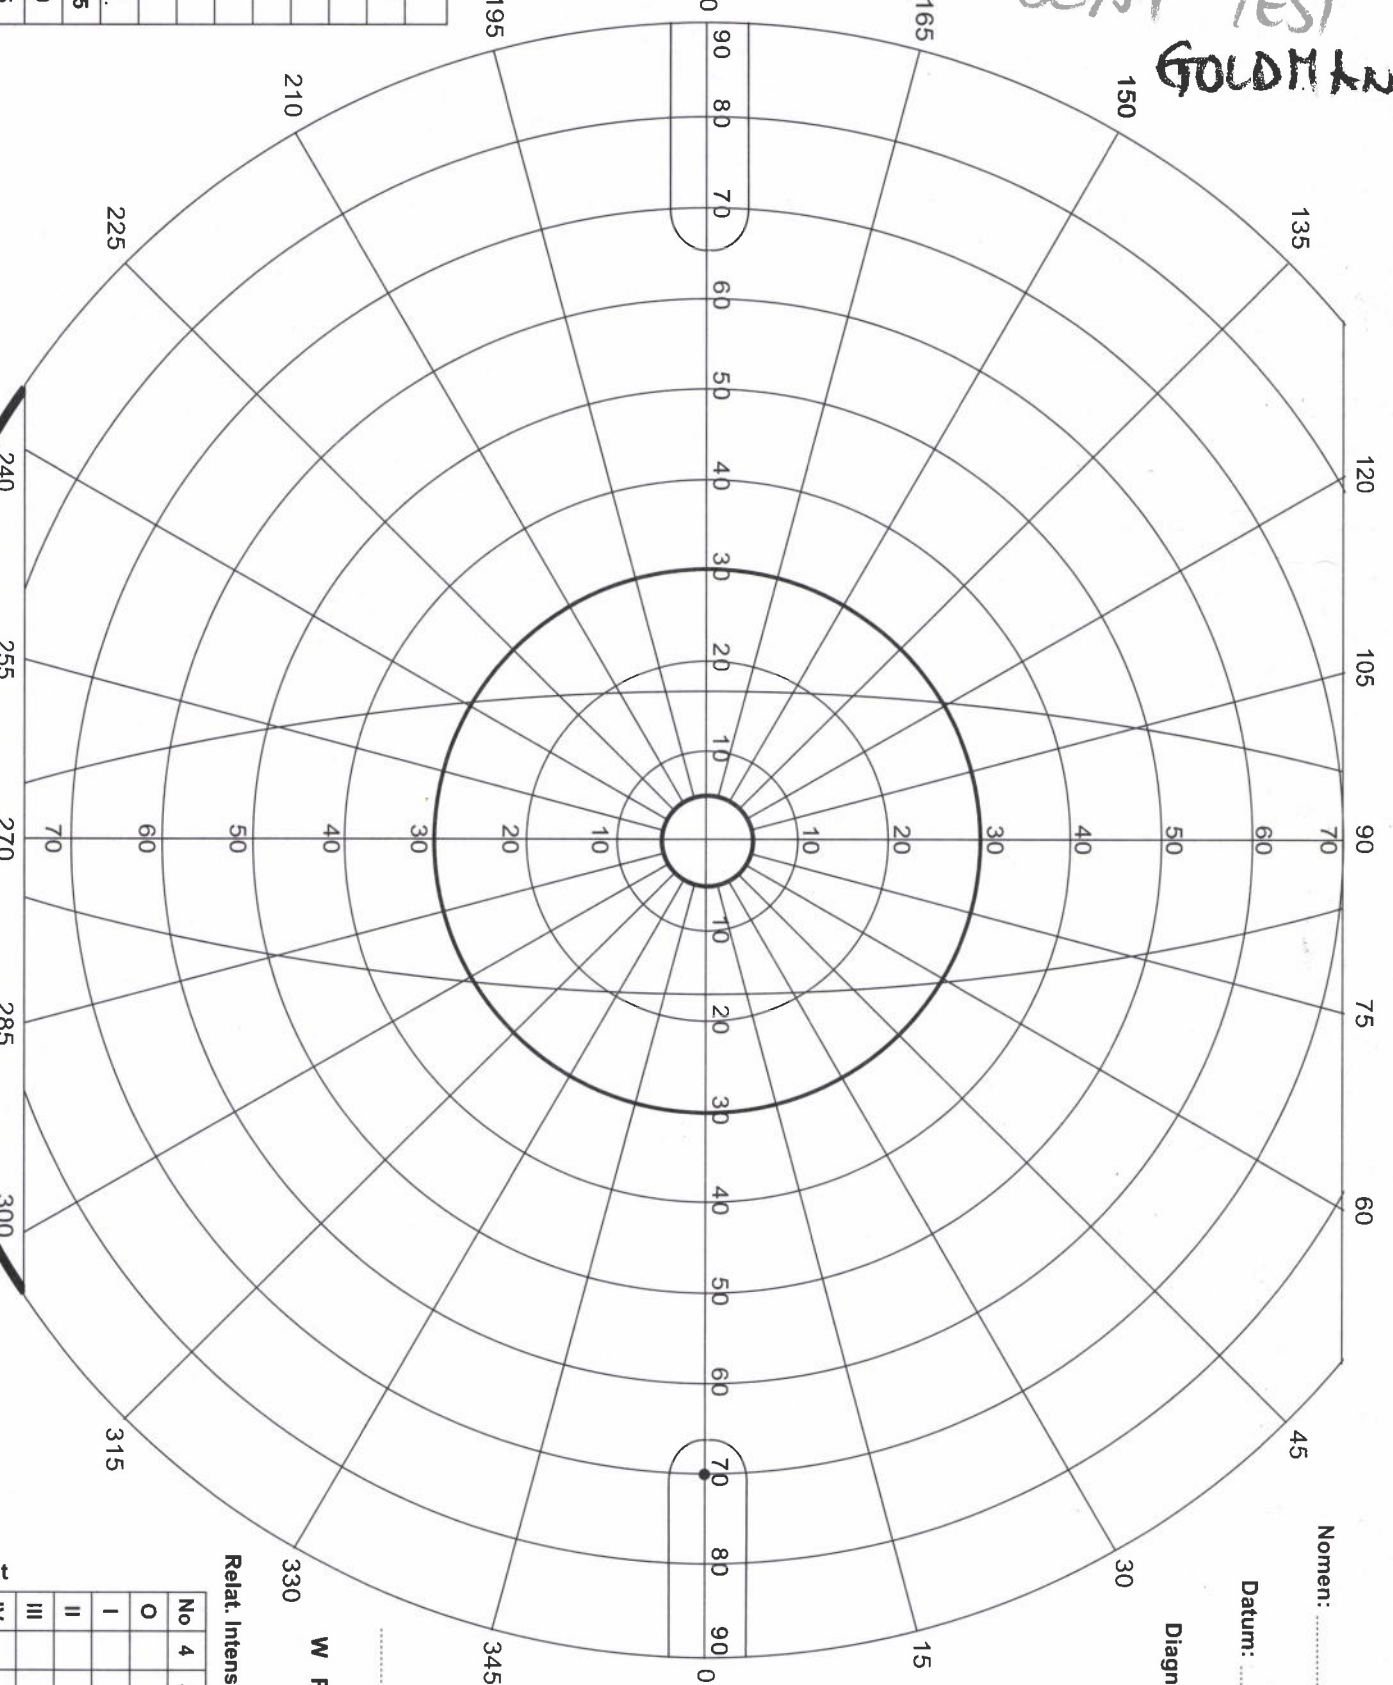

Für Seitenwechsel
Zeiger hier durchführen

OS. OD. Visus: sph C cyl ° =

Object				
No	4	3	2	1
O				
I				
II				
III				
IV				
V				

Relat. Intens. Correctio

W R G B Color

mm Diameter pupillae

Nomen:
Datum:
Diagnosis: